

15KV


10µm

X600 17mm


Handwritten text in red ink, possibly a sample ID or date.



Handwritten red text: 2.5 A11

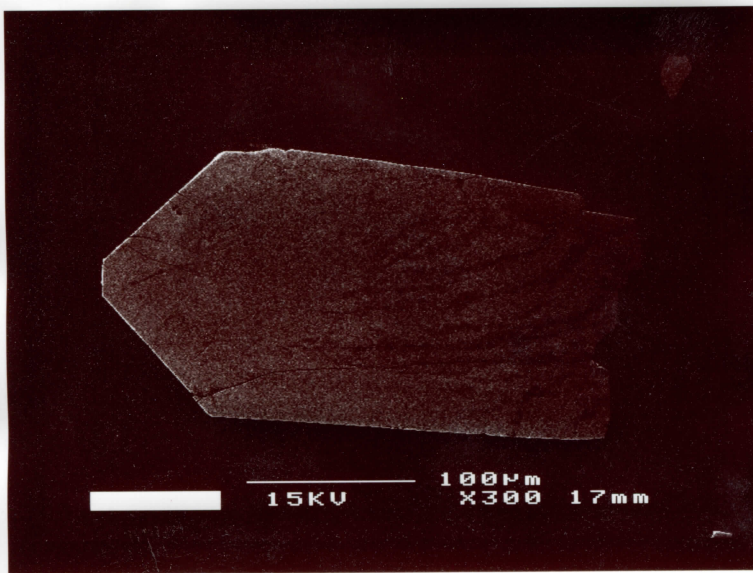

Handwritten red text: 2.5 A11

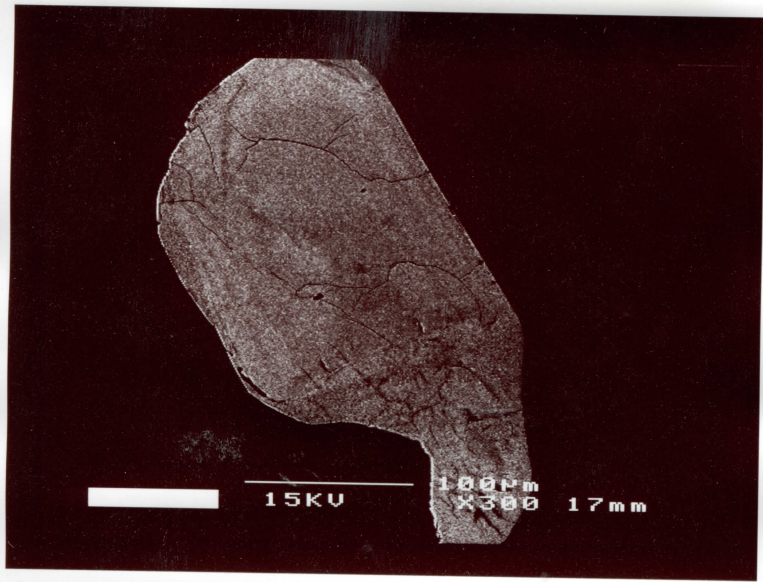


15KV

100µm

X300



17mm



Faint red markings or text, possibly a handwritten label or reference number, located below the micrograph.

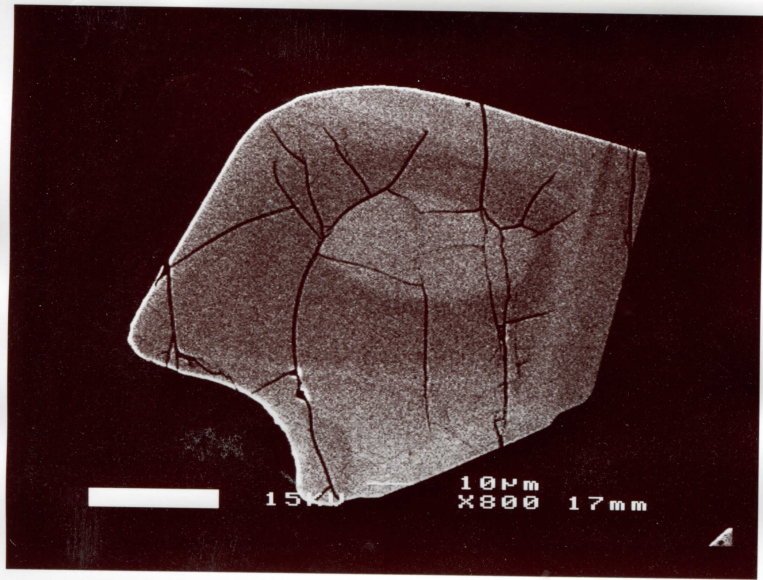


15. 10µm
X800 17mm

Handwritten red markings on the white border below the micrograph.

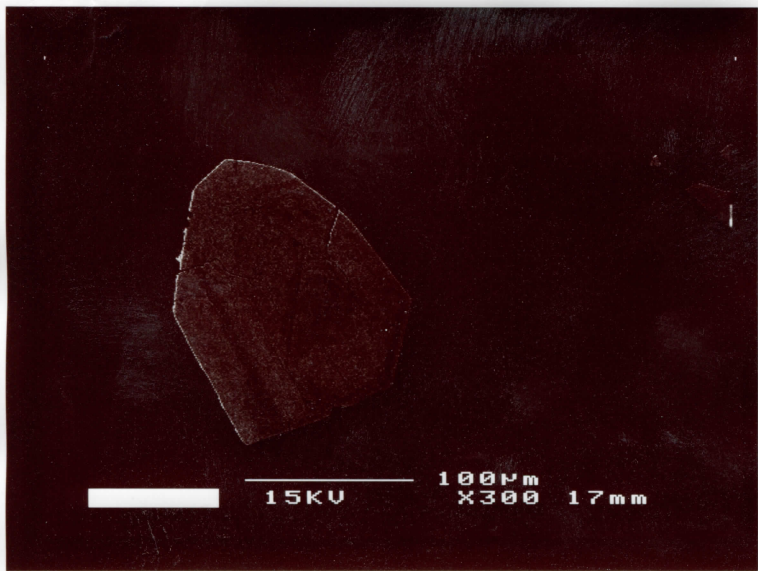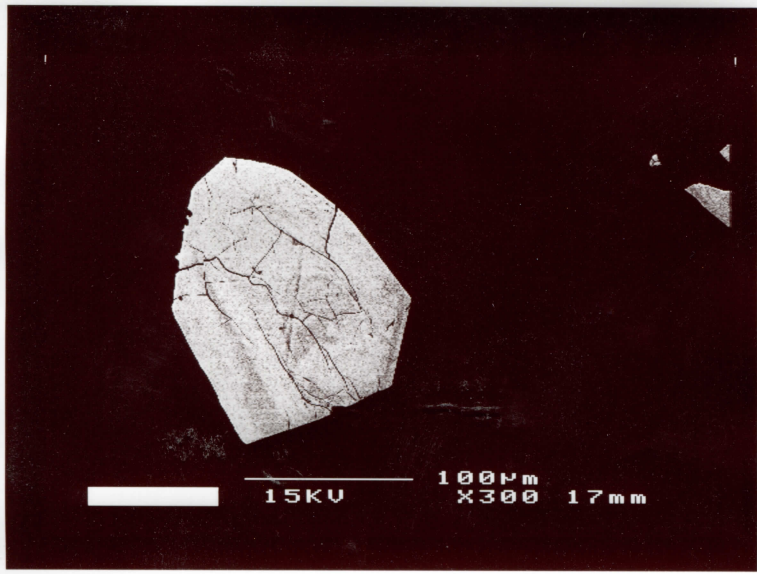

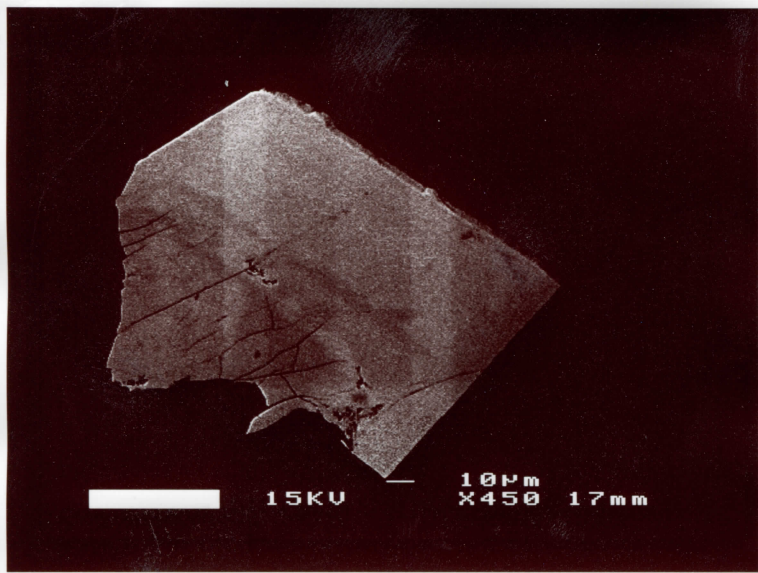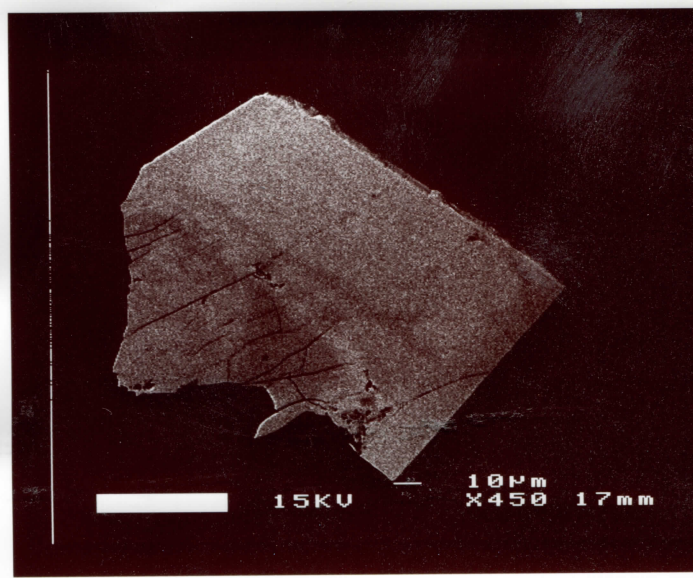



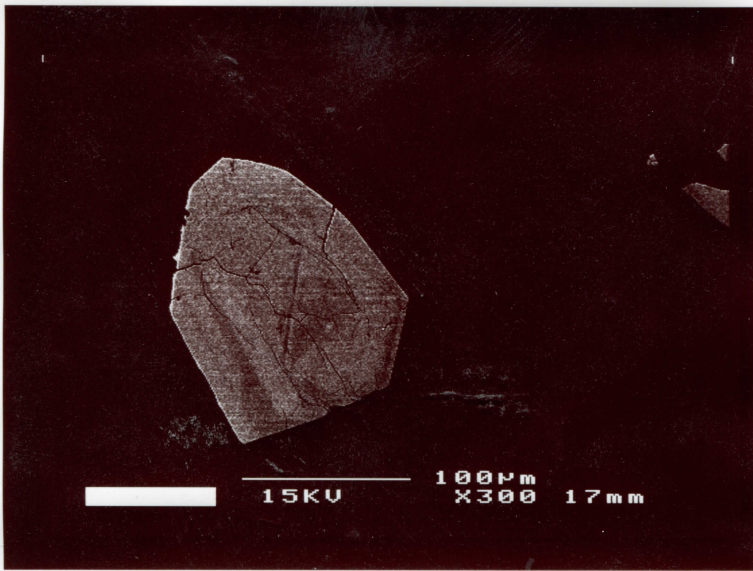






15KV

100µm

X300

17mm

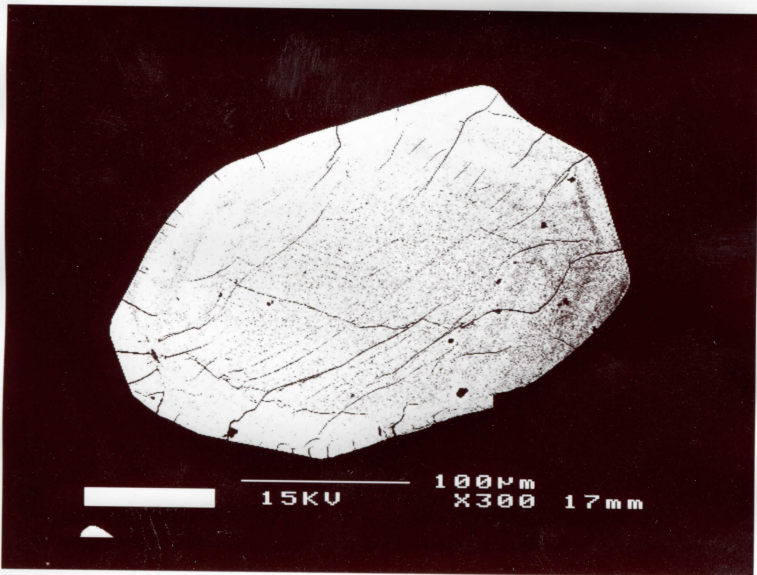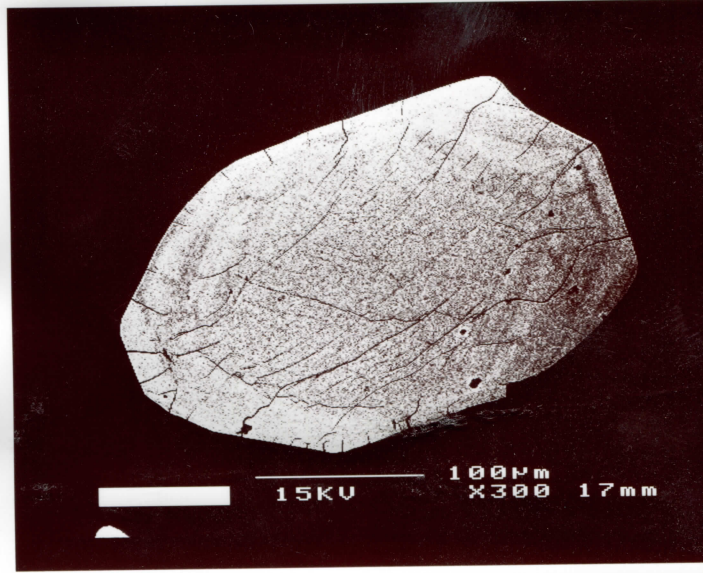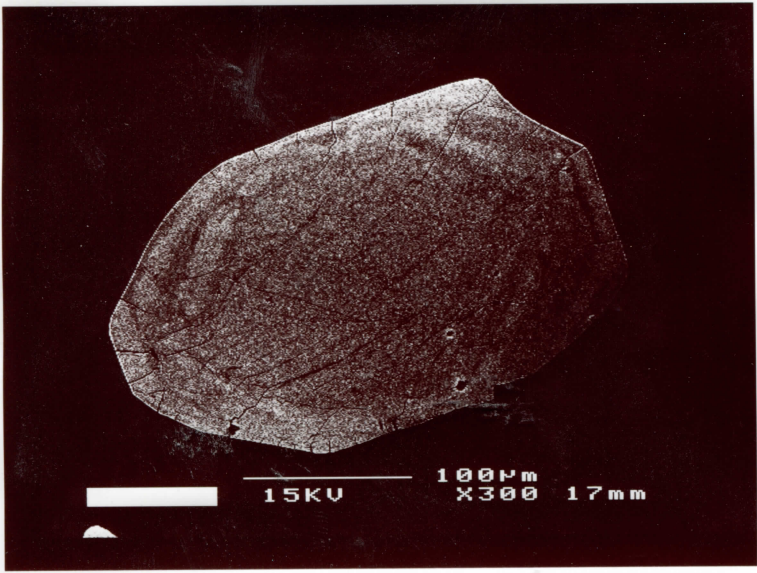

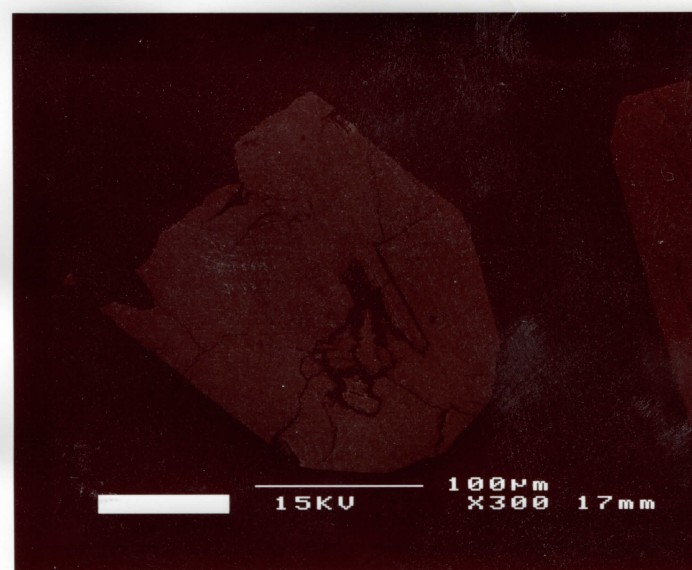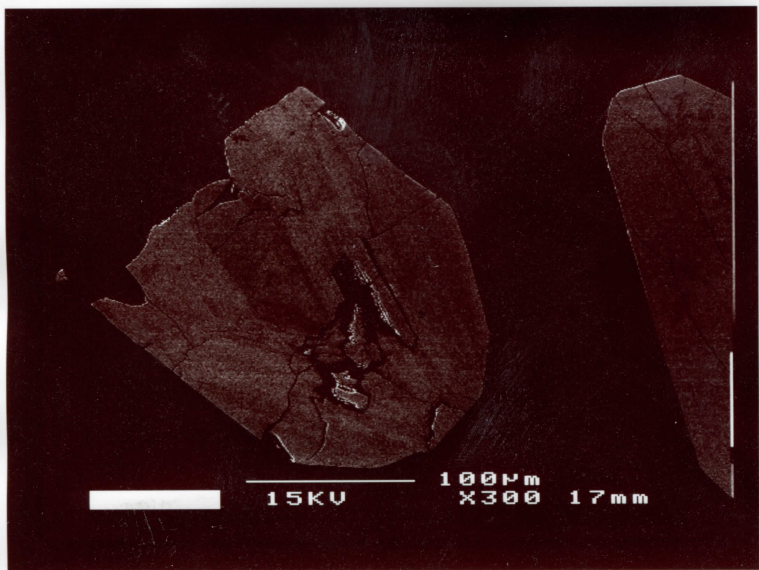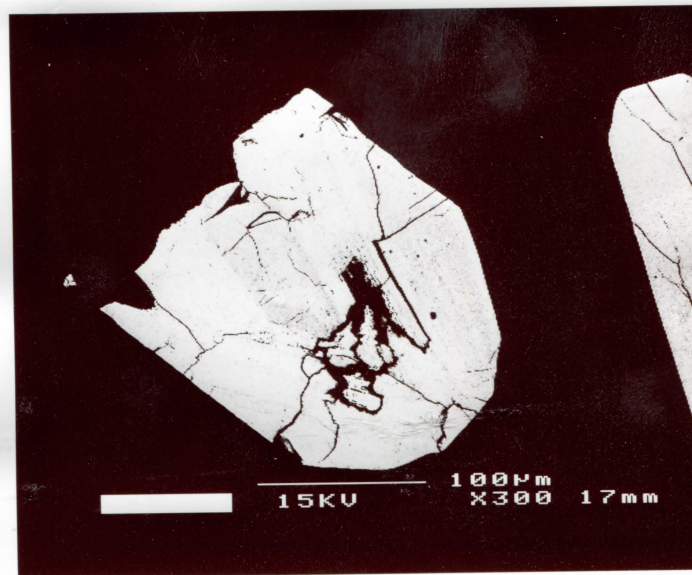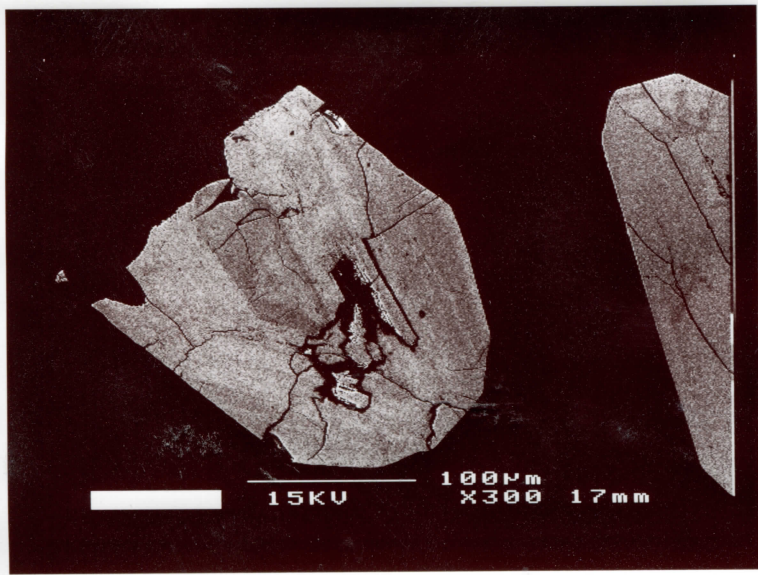



AKAUS