
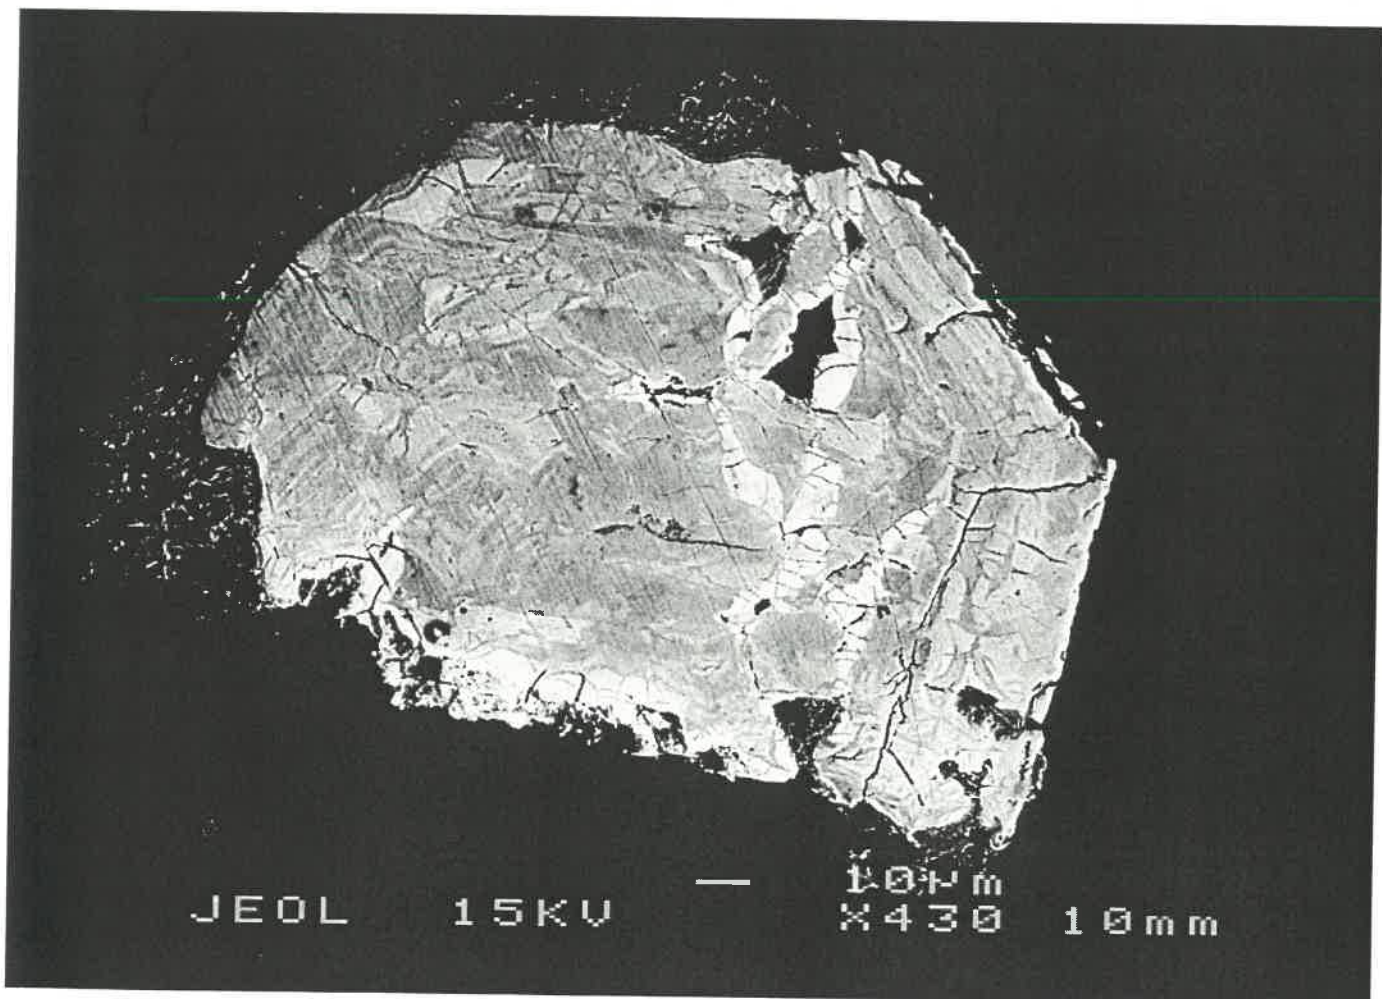



STDS

06:07  
C23

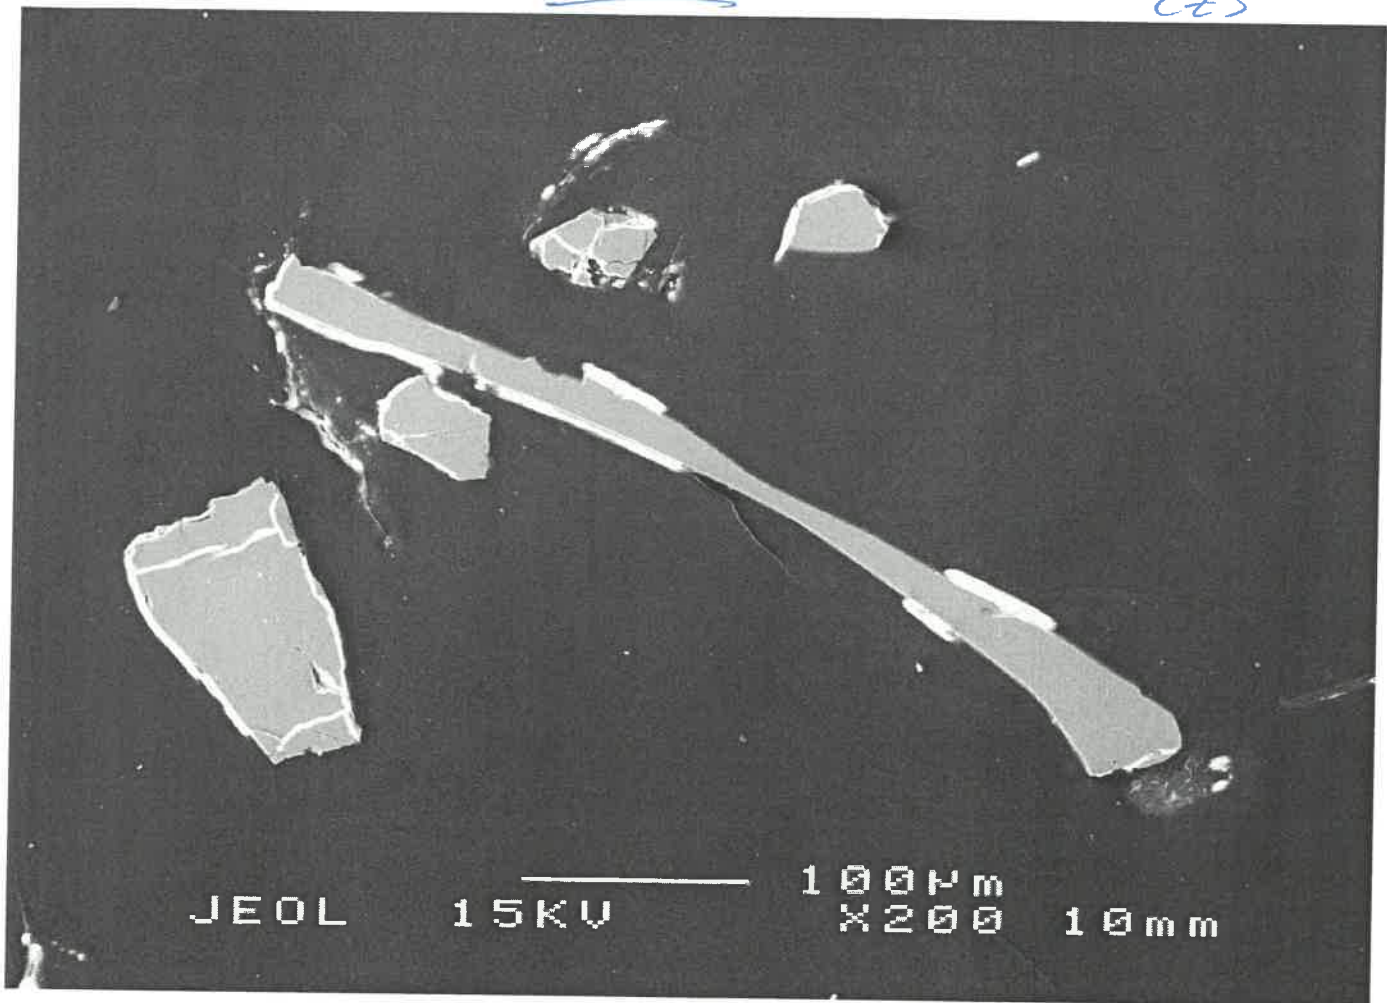


D24

06-07

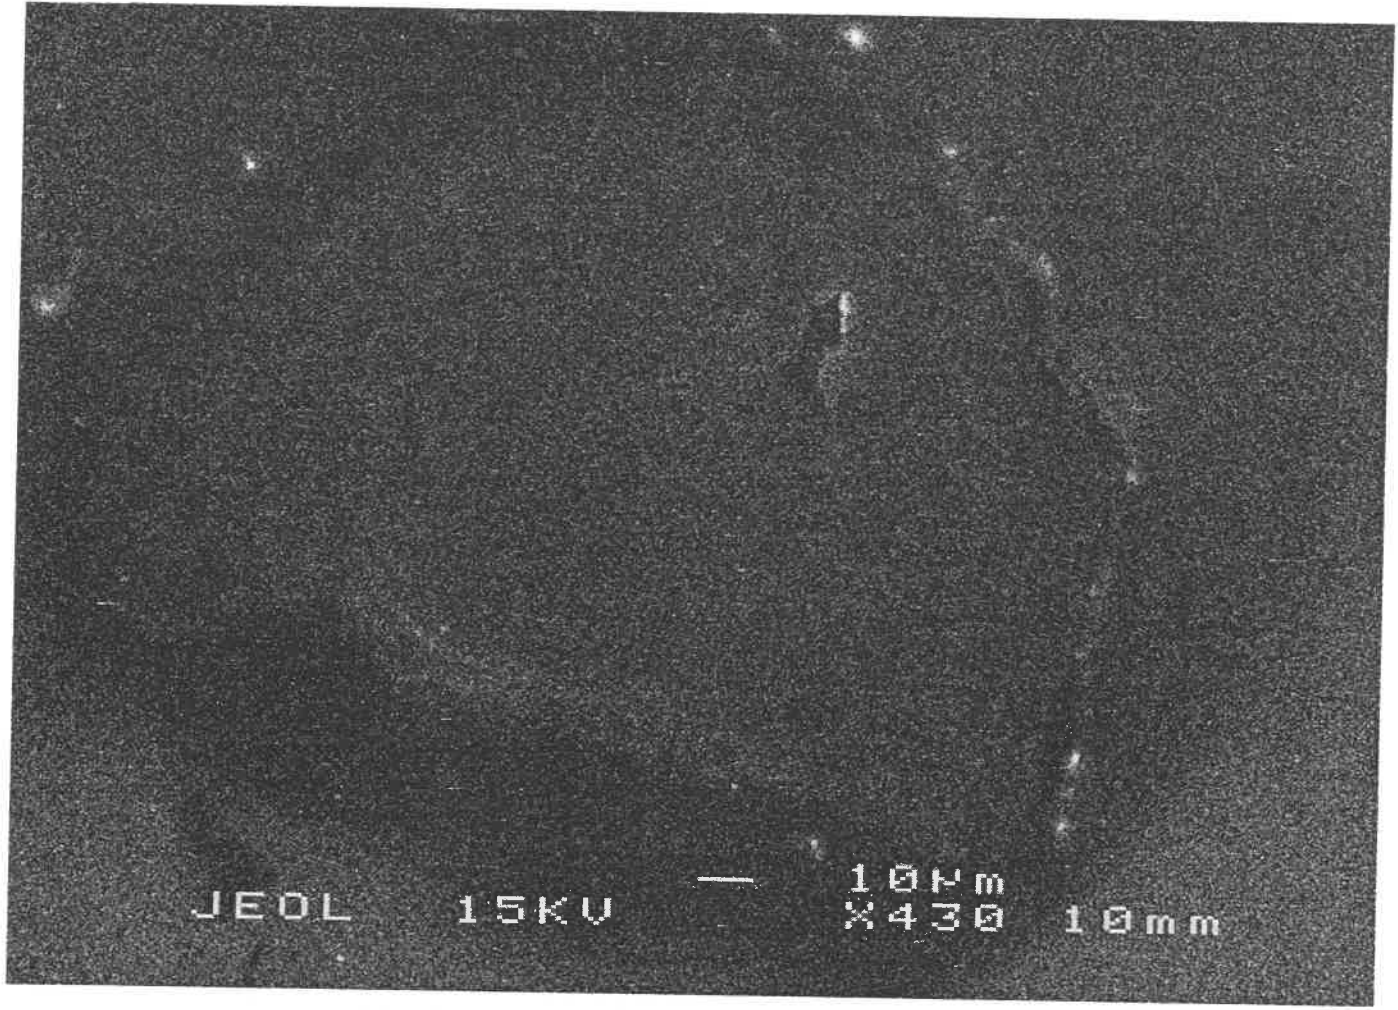

D24


JEOL 15KV — 100µm X430 10mm

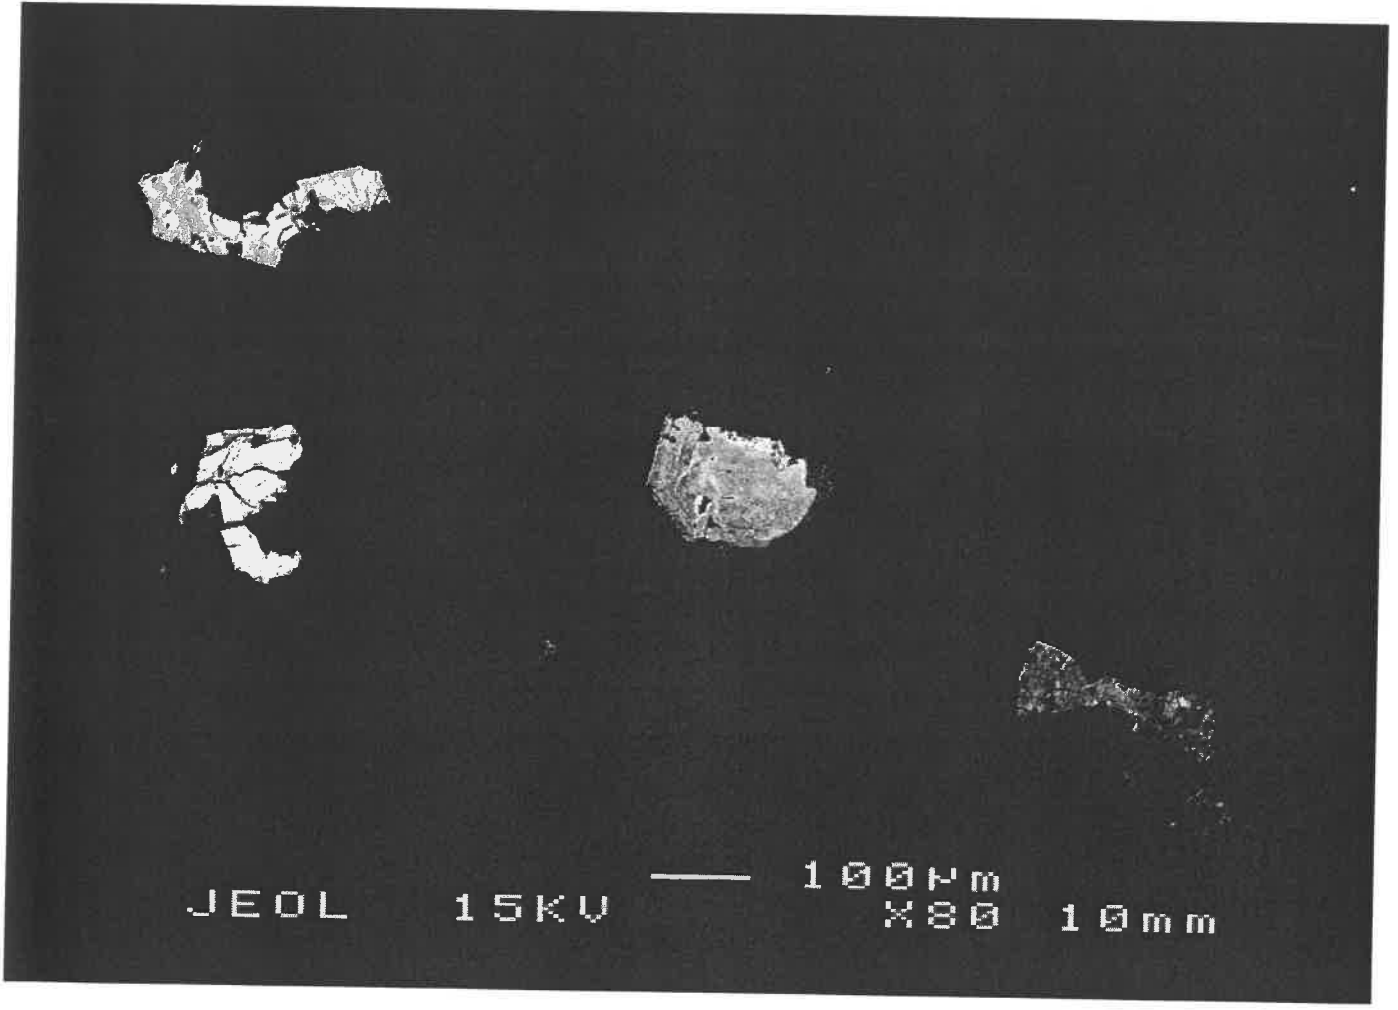

D24


JEOL 15KV — 100µm X80 10mm

06-07

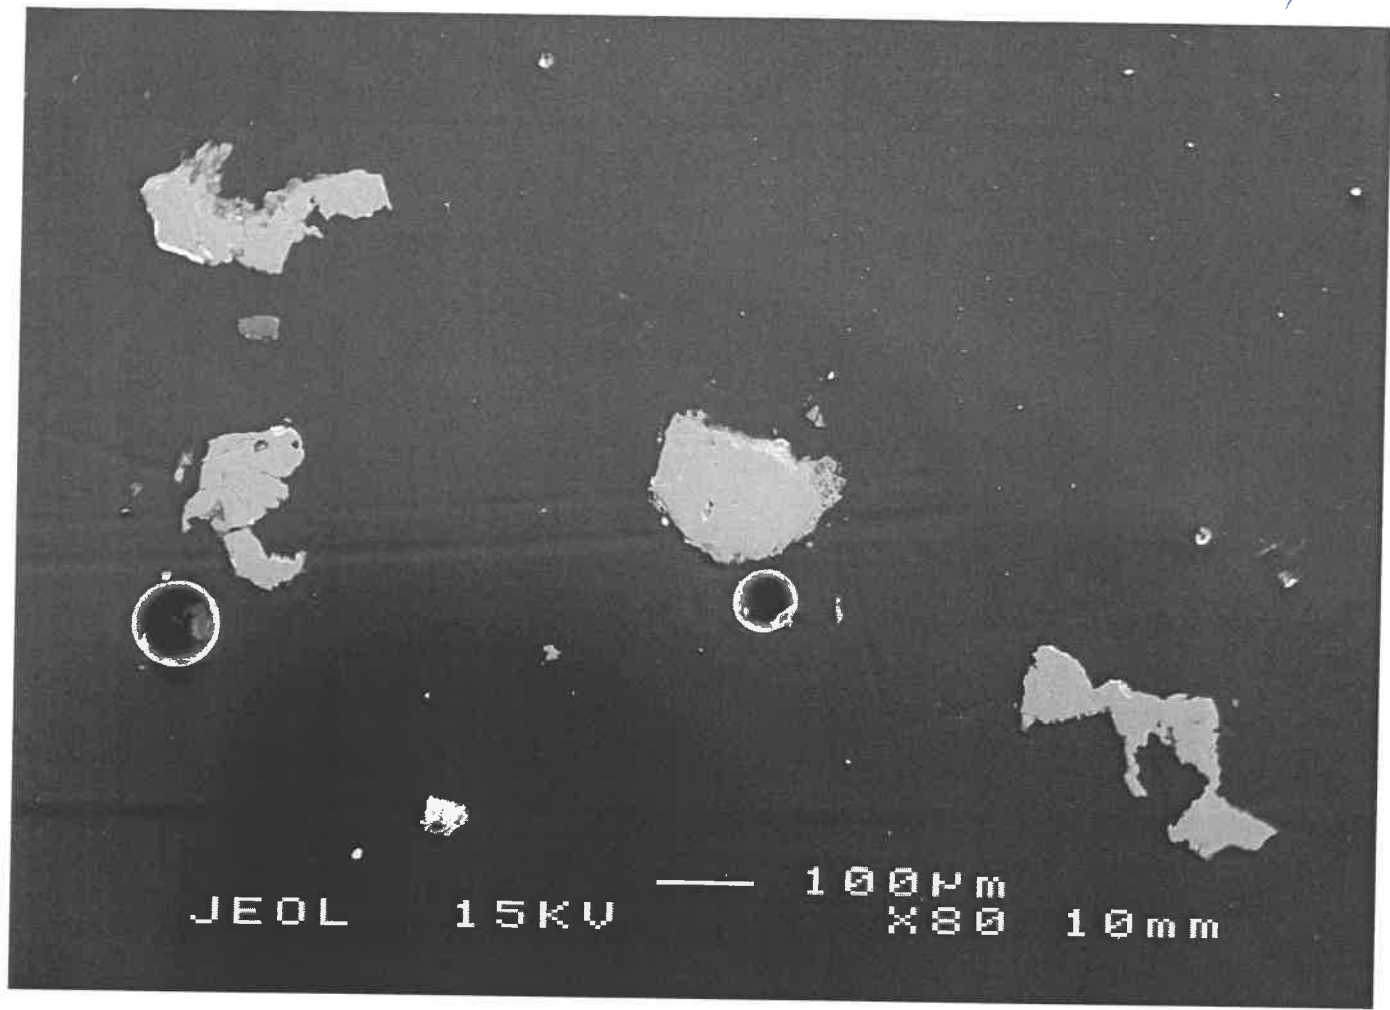

D24


JEOL 15KV — 100µm X80 10mm

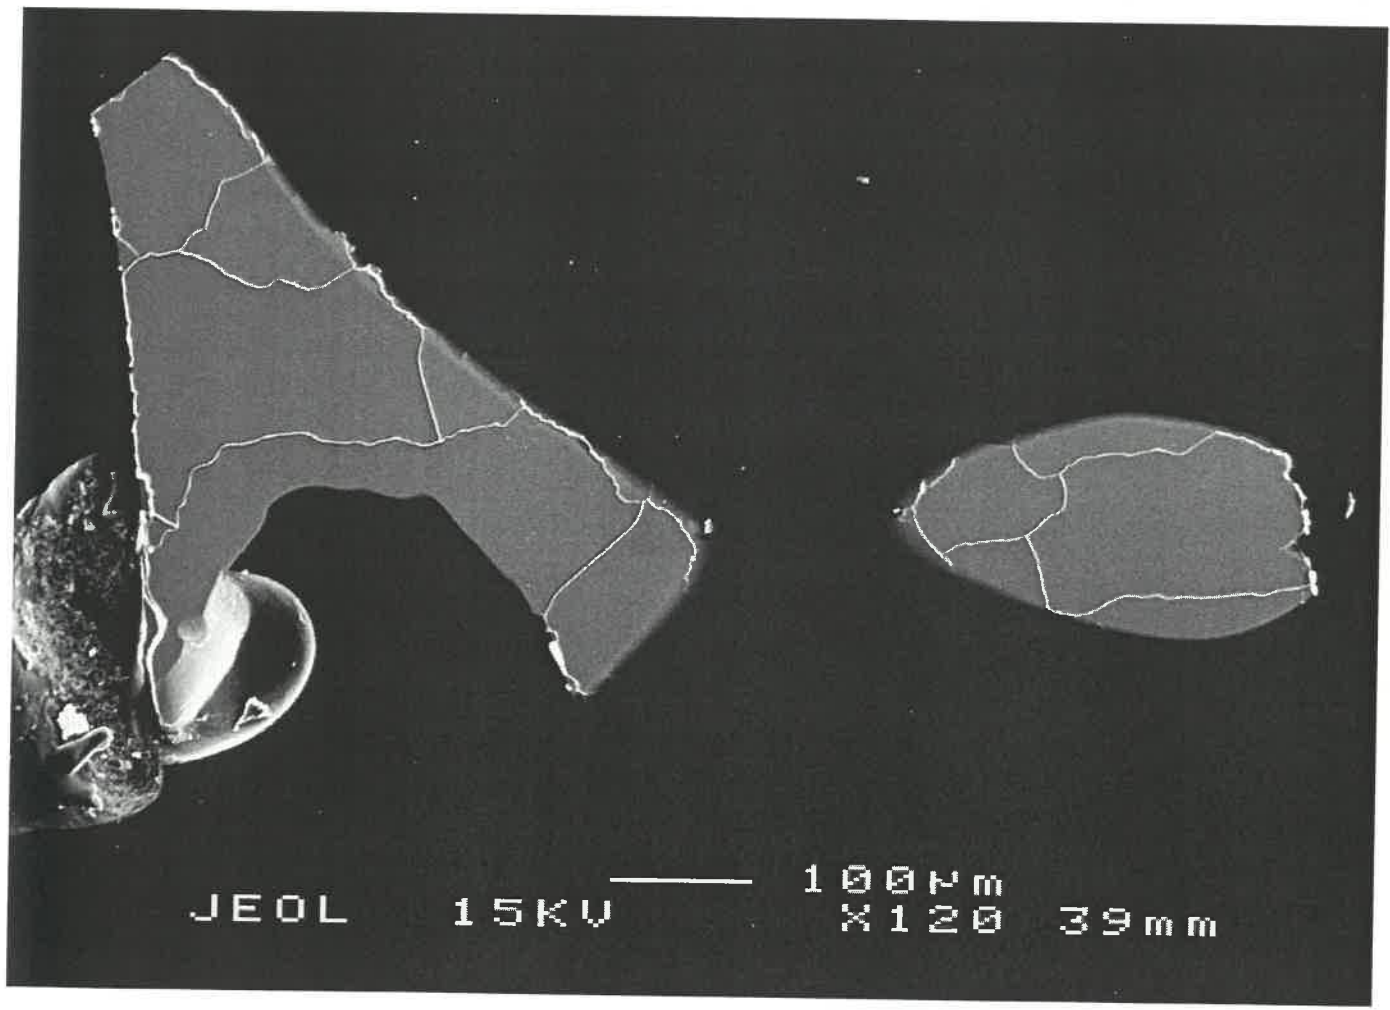



NBS  
611

JEOL 15KV — 100µm X120 39mm



06-07  
TEM

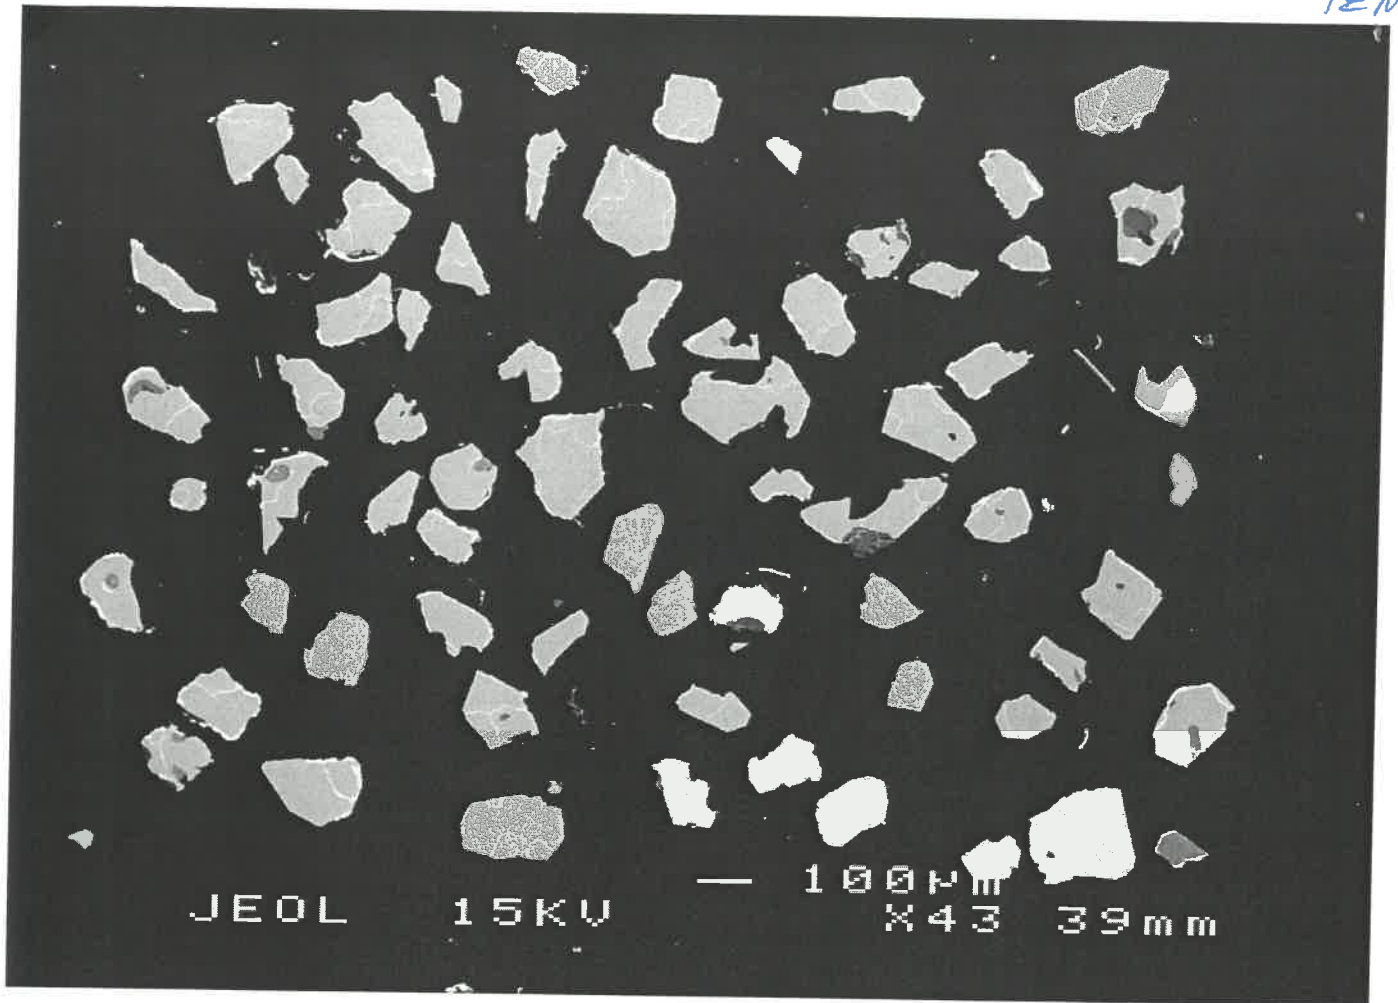



06-07  
TEM

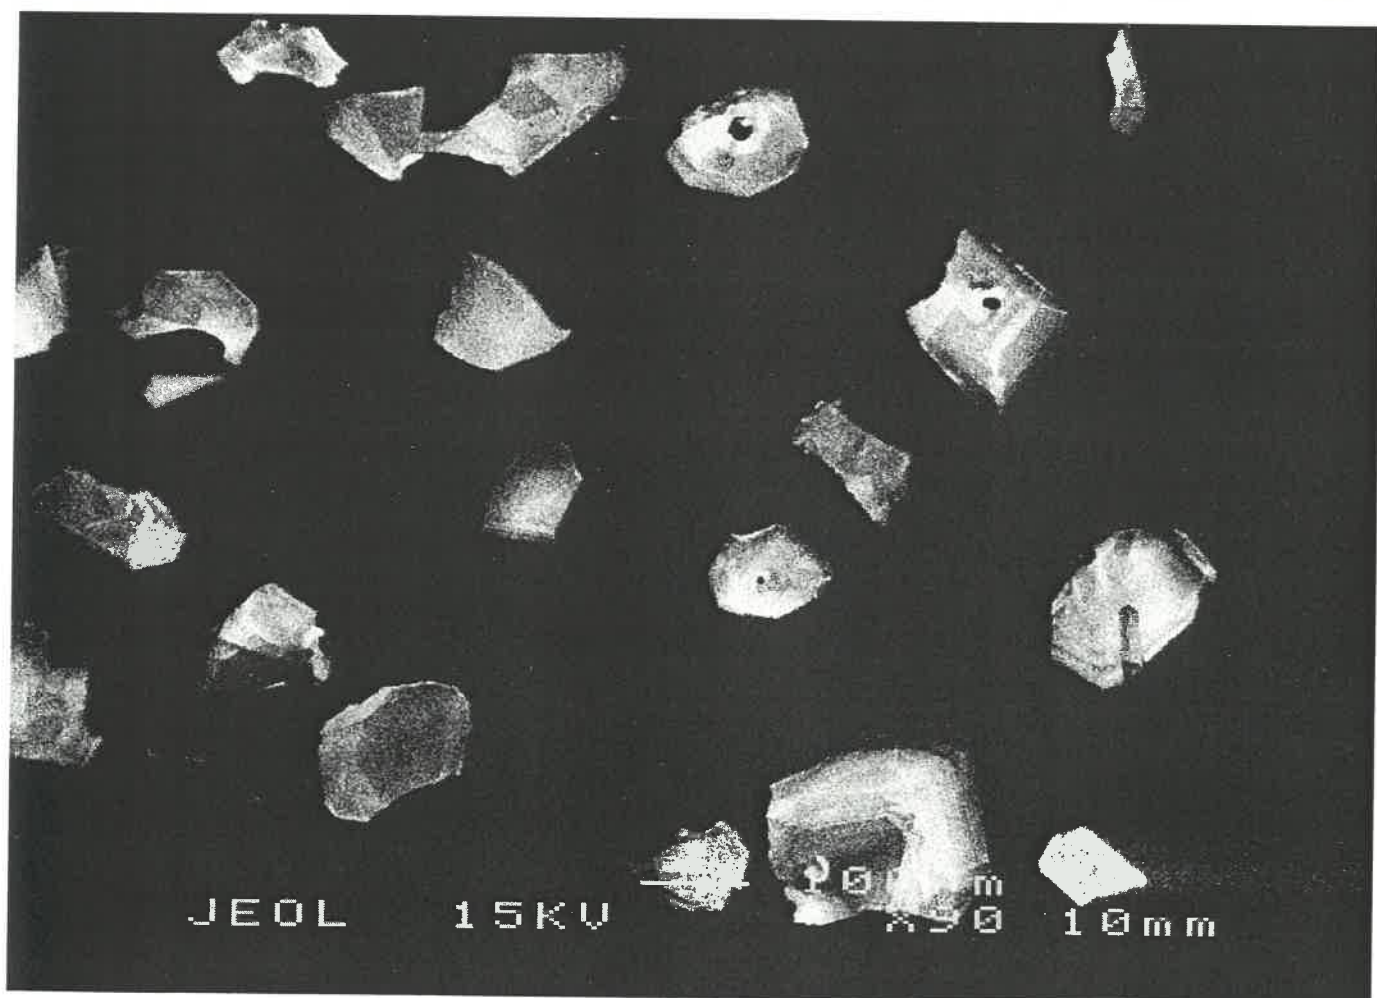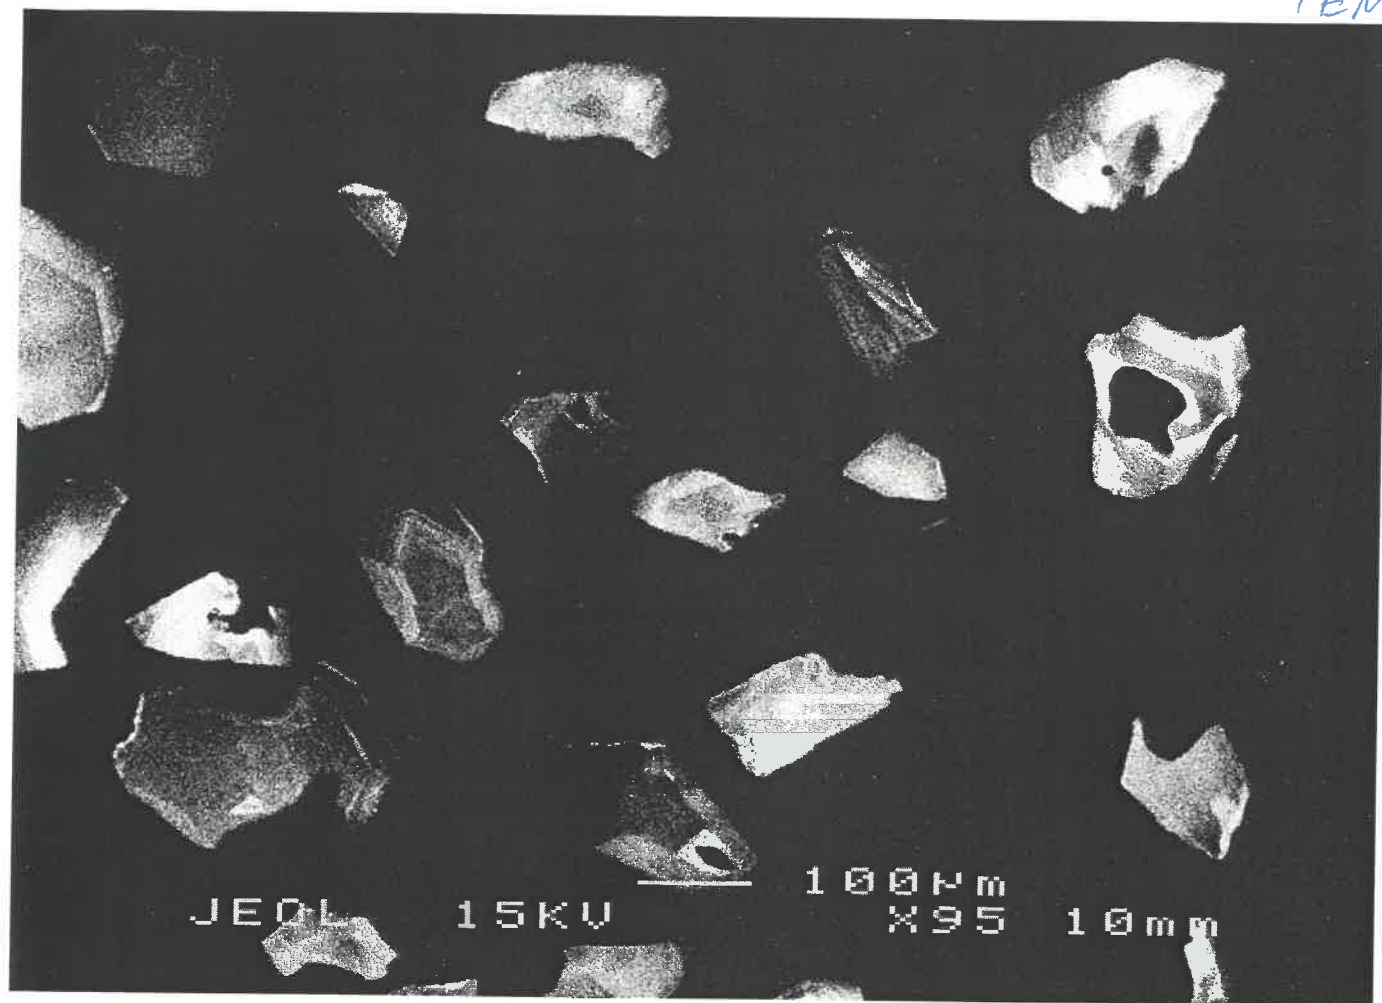


06-07  
TEM

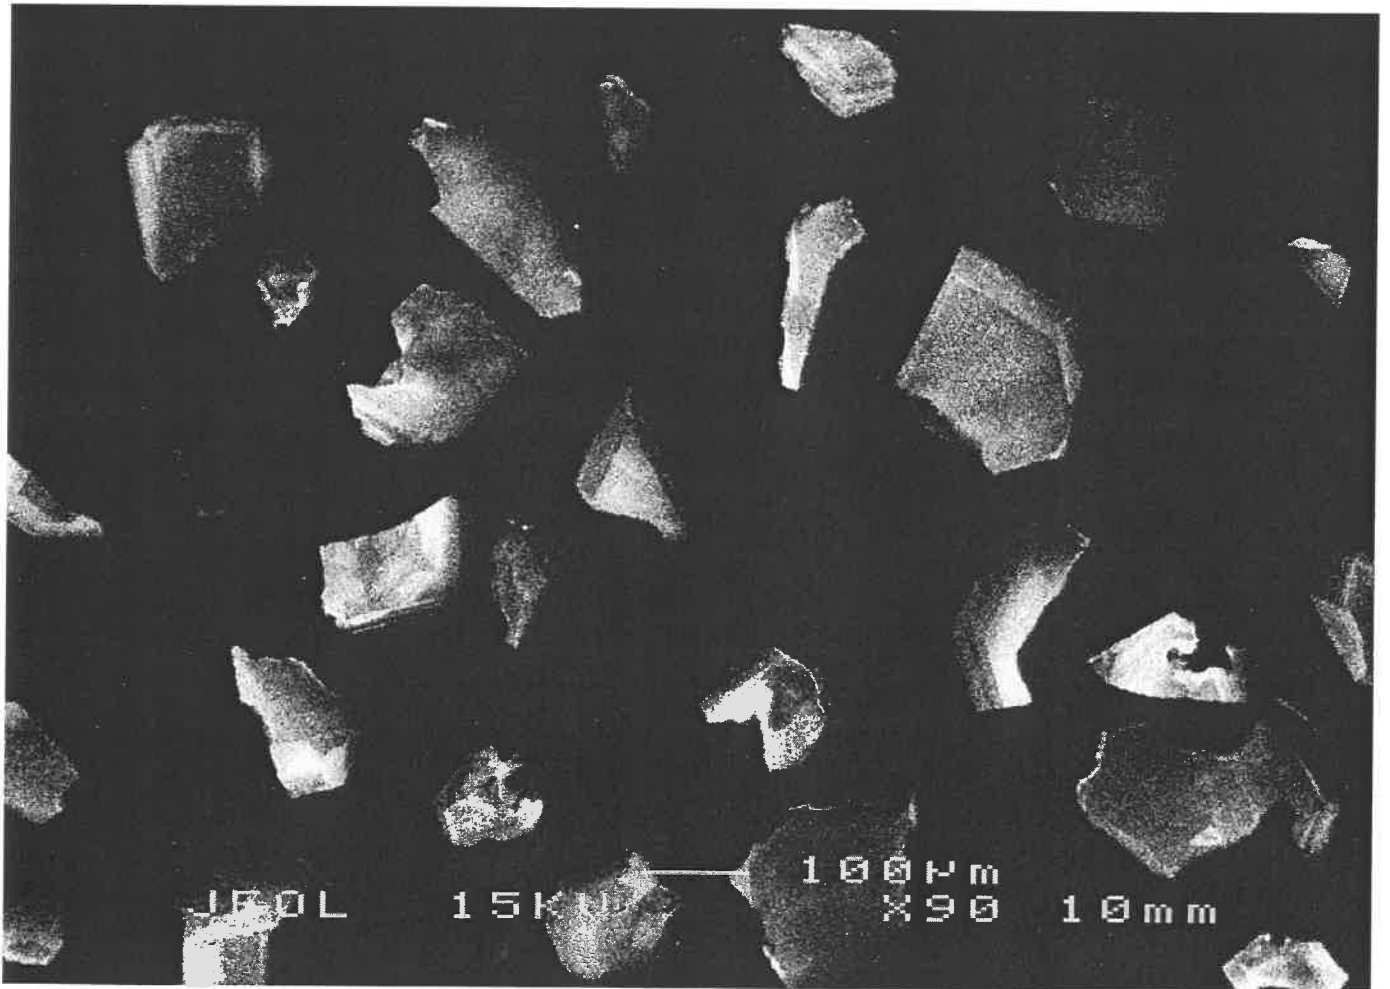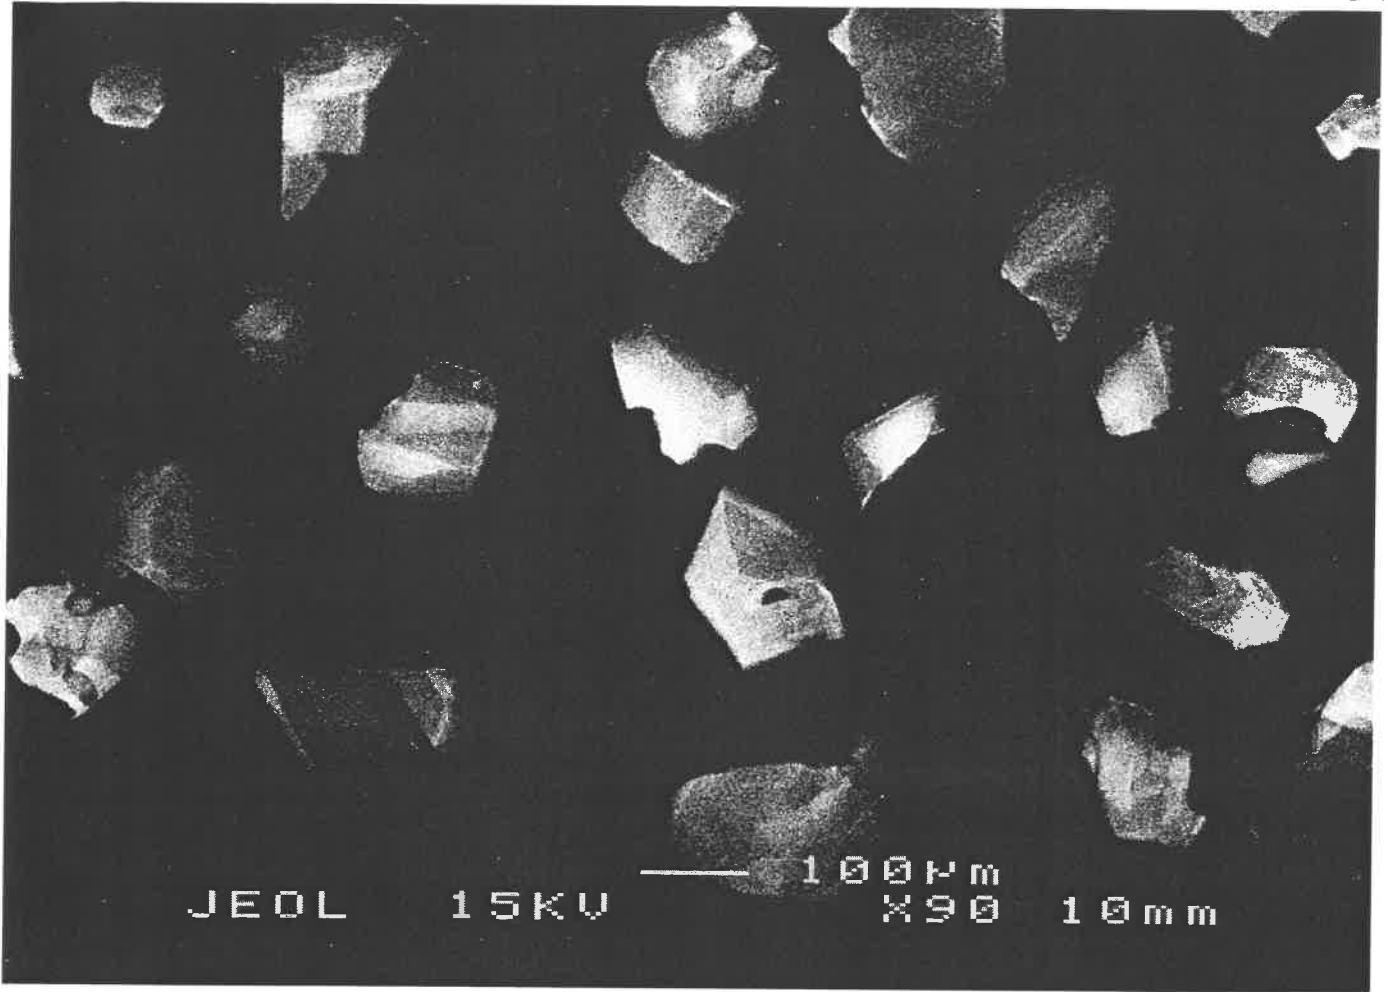

06-07  
TEM

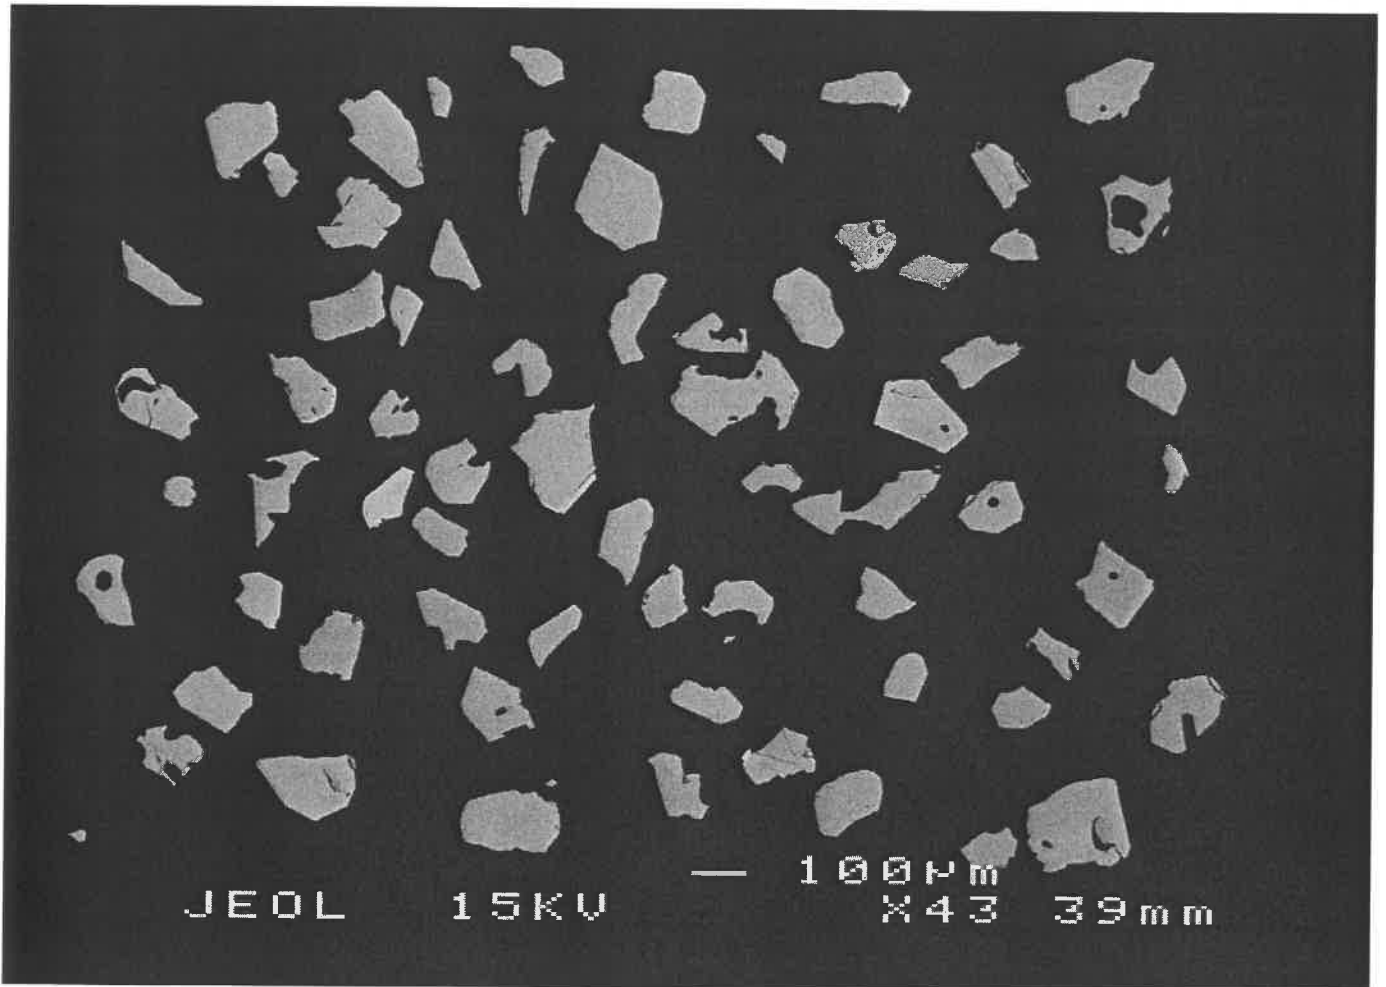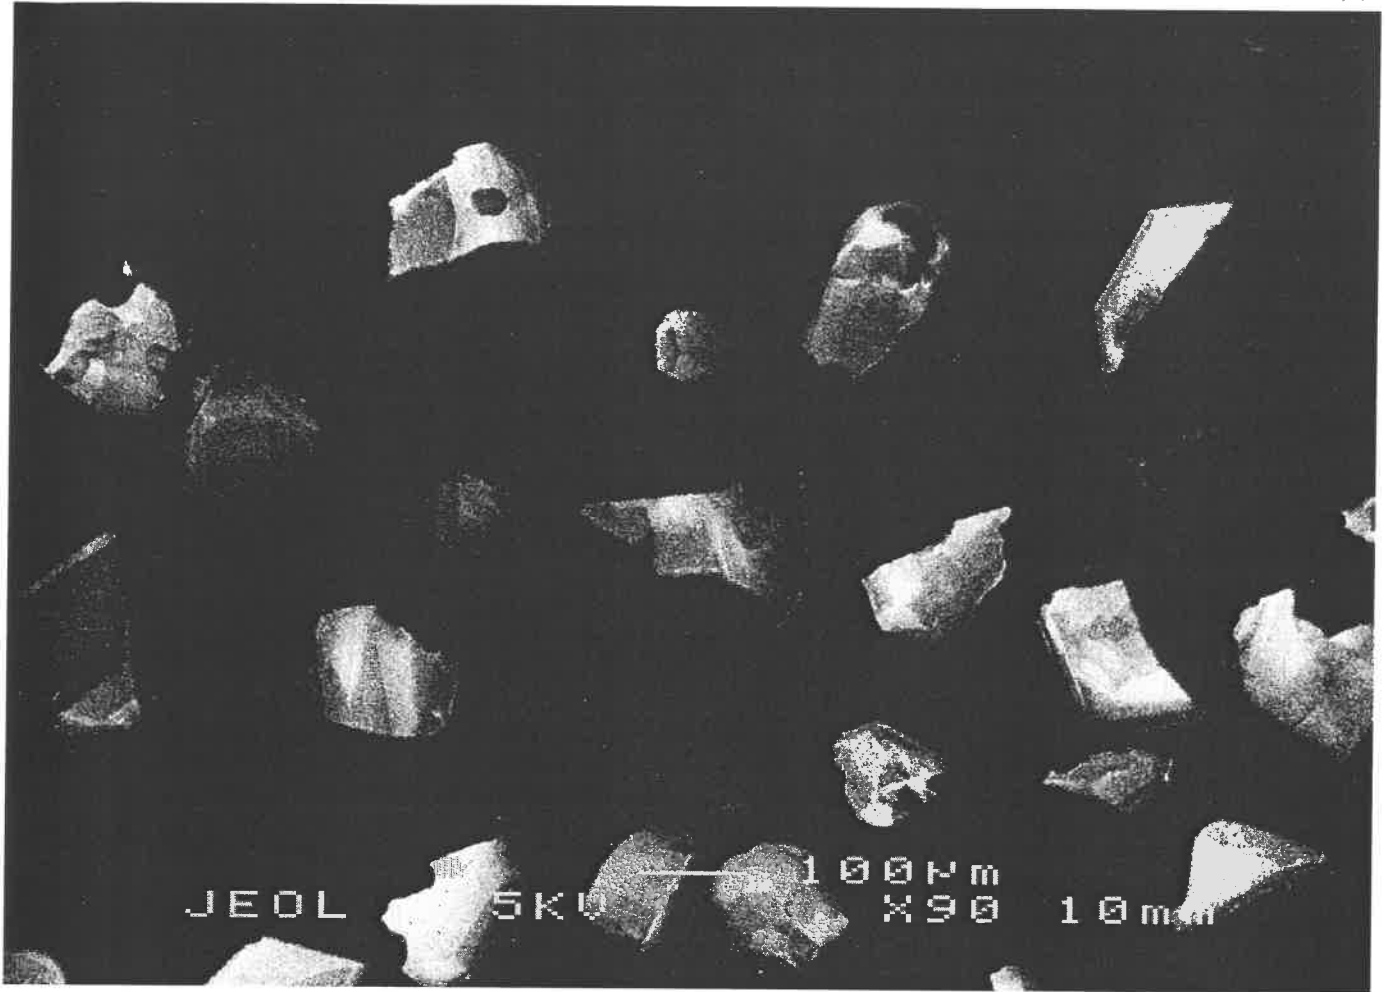

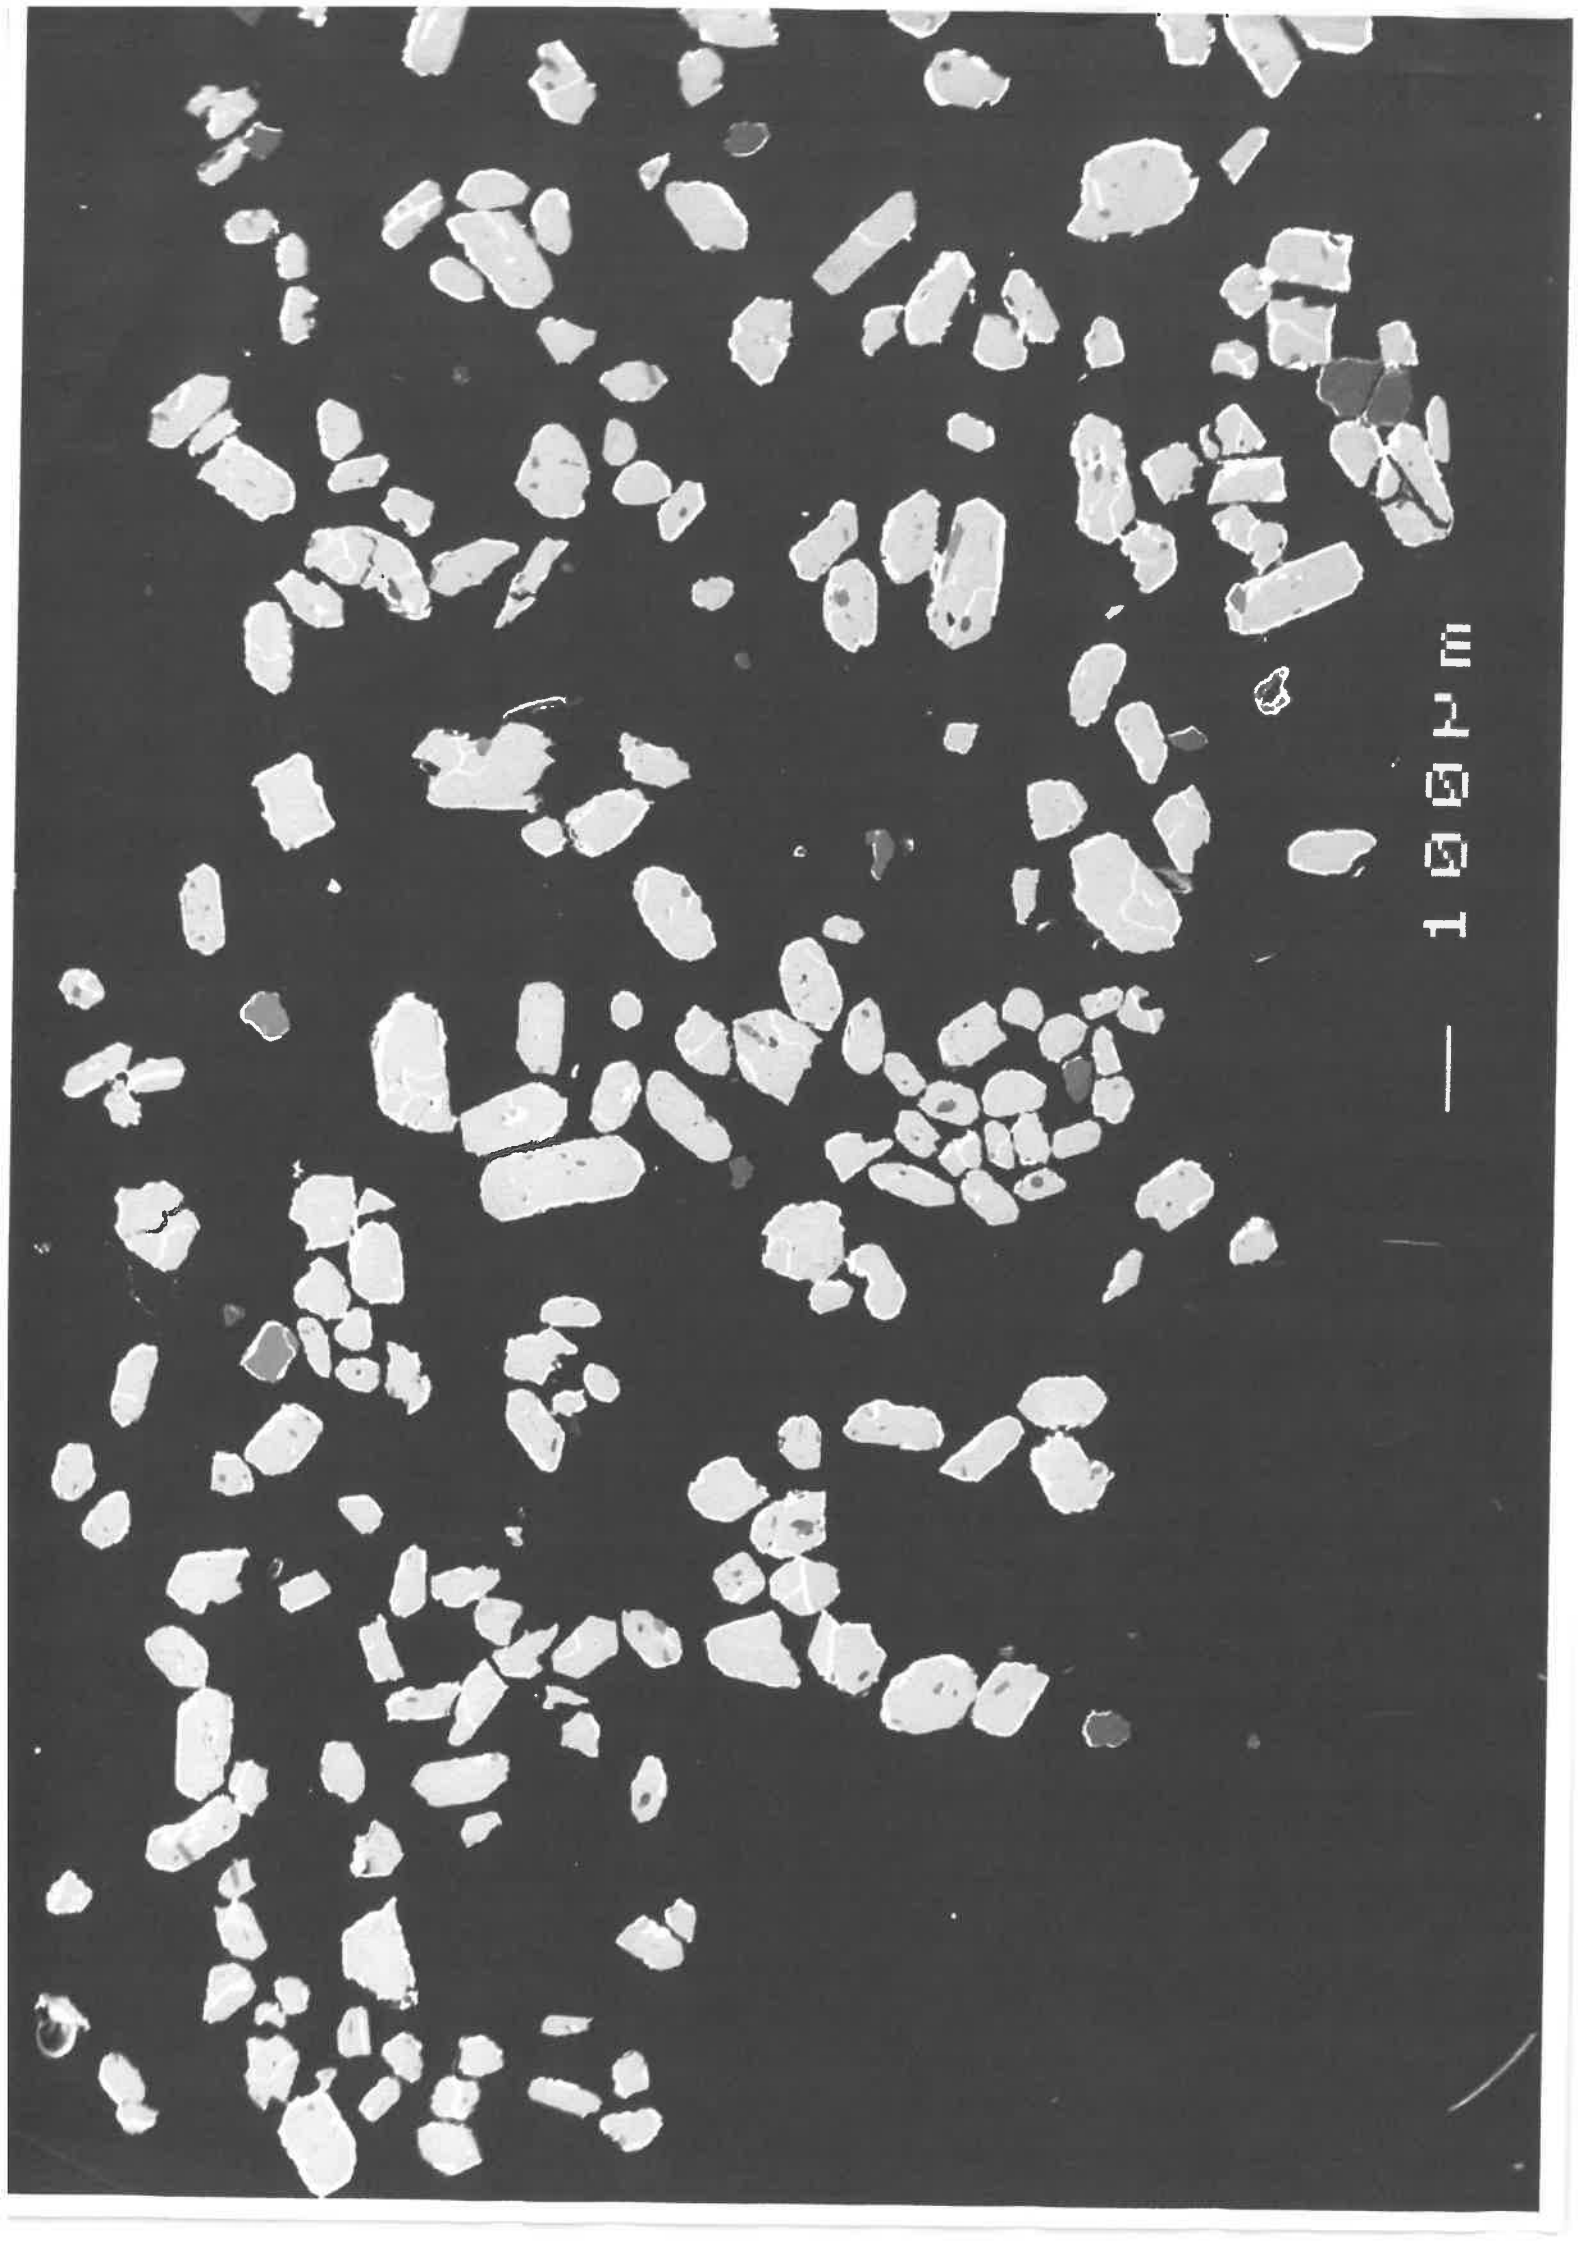

— 100 μm